

June 5, 2008

Michigan Electric Transmission, an ITC Company  
C/O Fernando Guevara  
27175 Energy Way  
Novi, MI 48377

Attention: Fernando Guevara, Property Management Specialist

SUBJECT: Single Phase, 4800 Volt Distribution line  
Reference No: 06808808/Bangor Twp/Bay County/Walker

REFERENCE: Amended and Restated Easement Agreement (the "Agreement") dated April 29, 2002, between Consumers Energy Company ("Consumers") and Michigan Electric Transmission Company, now Michigan Electric Transmission Company, LLC ("METC")

Pursuant to Section 7.1 of the Agreement, Consumers hereby notifies METC that Consumers intends to install a single phase distribution line on certain land in which METC has an interest under the Agreement. The location of the land on which said line will be constructed, and a further description of the intended use, are set forth on "Annex A", attached to this letter.

Under said Section 7.1 of the Agreement, METC must within 30 days of this notice notify Consumers, as "Initiating User," of whether or not METC approves the proposed use as a Compatible Use. If you do not notify us either way within 30 days of this notice, then, as provided in said Section 7.1, METC will be deemed to have approved the proposed use as being a Compatible Use. We would appreciate, however, receiving METC's express approval of the proposed use as being a Compatible Use as soon as possible so that we can start work without delay.


June 5, 2008

Page Two

Reference No: 06808808/Bangor Twp/Bay County/Walker

This letter is being sent to you in duplicate. If METC agrees that the proposed use is a Compatible Use, please indicate that by signing and returning a copy of this letter to us as soon as possible, so that we can immediately proceed with construction. The other copy is for your records.

Very truly yours,

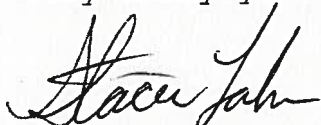


Stacie Lahr  
Consumers Energy  
One Energy Plaza  
Jackson, MI 49201

APPROVED:

MICHIGAN ELECTRIC TRANSMISSION  
COMPANY, LLC

By: \_\_\_\_\_

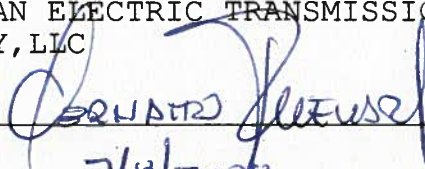

Date: \_\_\_\_\_

7/8/2008

ANNEX A

Reference No: 06808808/Bangor Twp/Bay County/Walker

LAND TO BE IMPACTED:

Land located in the Township of Bangor, County of Bay, State of Michigan, described as follows:

**That part of the Southeast 1/4 of Section 5, Township 14 North, Range 05 East, running along State Park Dr.**

PROPOSED USE:

**Will run parallel to the METC line with underground primary conductor joint with gas to feed 237 State Park Dr. See attached 391 form and sketch.**

Prepared by:  
Stacie M Lahr 06/05/08  
Consumers Energy Company  
EP7-436  
One Energy Plaza  
Jackson, MI 49201



Date: July 7, 2008

To: Fernando Guevara  
Real Estate and Rights of Way  
ITC

From: Ashley DuPree  
Engineering  
ITC

Subject: **UBA081500/CU-347**  
CE Reference No. 06808808/Bangor Twp/Bay County/Walker  
Three Phase, 14.4/24.9 Distribution Line

This request is hereby approved under the following condition:

1. No disturbance of soil shall take place within 20 feet of the electric transmission tower.

Approved

By David Doubly  
David Doubly  
Staff Engineer



Real Estate and Claims Division

---

**Project No: UBA081500  
CU-347**

Date: June 16, 2008  
To: David Doubley  
From: Fernando Guevara  
Real Estate

Subject: Three Phase, 14.4/24.9 kV Distribution Line  
CE Reference No. 06808808//Bangor Twp/Bay County/Walker

The attached request was received from Consumers Energy. CE intends to install a single phase distribution line. The proposed line will run parallel to the METC line with underground primary conductor joint with gas to feed 237 State Park Dr. Furthermore, pursuant to the Amended and Restated Easement Agreement, METC/ITC needs to submit a response letter to CE by **July 14, 2008**.

Please review and return to my attention with your recommendations/comments.

Attachments

CONSUMERS ENERGY  
**NOTIFICATION OF PROPOSED LINE CONSTRUCTION  
REQUIRING COORDINATION WITH TRANSMISSION LINES**

Send two (2) copies to:

Transmission Lines Design and Standards

Att: Yvonne Ross

Jackson, Michigan

**TO BE FILLED IN BY SYSTEM OWNER / ENGINEER / CES**

Headquarters Bay City

Work Order No. 06808808

Date 06/03/2008

**PROPOSED DISTRIBUTION CONSTRUCTION**

Sketch Attached  Yes  No

Primary:

Voltage 4800 Phase single

No. of Wires 1 Crossarms Per Pole \_\_\_\_\_

Wire Size 1/0 Length of Crossarms \_\_\_\_\_

Distance Below Transmission Underground Primary

Skip-Span  Yes  No

Secondary:

No. of Wires \_\_\_\_\_ Wire Size \_\_\_\_\_

Other Details:

**TO BE FILLED IN BY TRANSMISSION LINES DESIGN  
AND STANDARDS OR METC**

Engineering Required  Yes  No

Checked By \_\_\_\_\_ Date \_\_\_\_\_

GWO No. \_\_\_\_\_

**EXISTING DISTRIBUTION FACILITIES**

Description: We are going to run parallel to the metc line with underground primary conductor joint with gas to feed 237 state park dr. (see attached Print)

**LOCATION**

Township Bangor County Bay

Section 05 Range 05E

Transmission Line Involved bangor-monitor line, wackery-weadock line, and iosco-karn line

Transmission Pole No. 4235, 4236

**REMARKS:**

Prepared By Scott Walker 989-667-5153 Date 6/3/08  
System Planning and Performance / Electric Service

Approved By \_\_\_\_\_ Date \_\_\_\_\_  
Transmission Lines Design and Standards

Approved By \_\_\_\_\_ Date \_\_\_\_\_  
METC

METC lines are subject to the easement rights of METC. Your request has been forwarded to Real Estate for processing and will require a 30-day period prior to approval. Initiation of any construction activities without appropriate METC approval may require relocation or removal of the lines at your expense.

# BAY C


## HAMPTON TWP. BANGOR TWP.

W. PORTION S. PORTION

SCALE 1" = 1000'  
REDUCED SCALE 1" = 2000'

RIGHTS  
E RIGHTS  
SOLD


- ELEC. TRANS R/W.
- ▨▨▨▨ ELEC TRANS STRIP EASEMENT
- +— COMMUNICATION R/W.
- + + + INGRESS & EGRESS R/W.
- + + + OVERHANG RIGHTS
- TREE RIGHTS

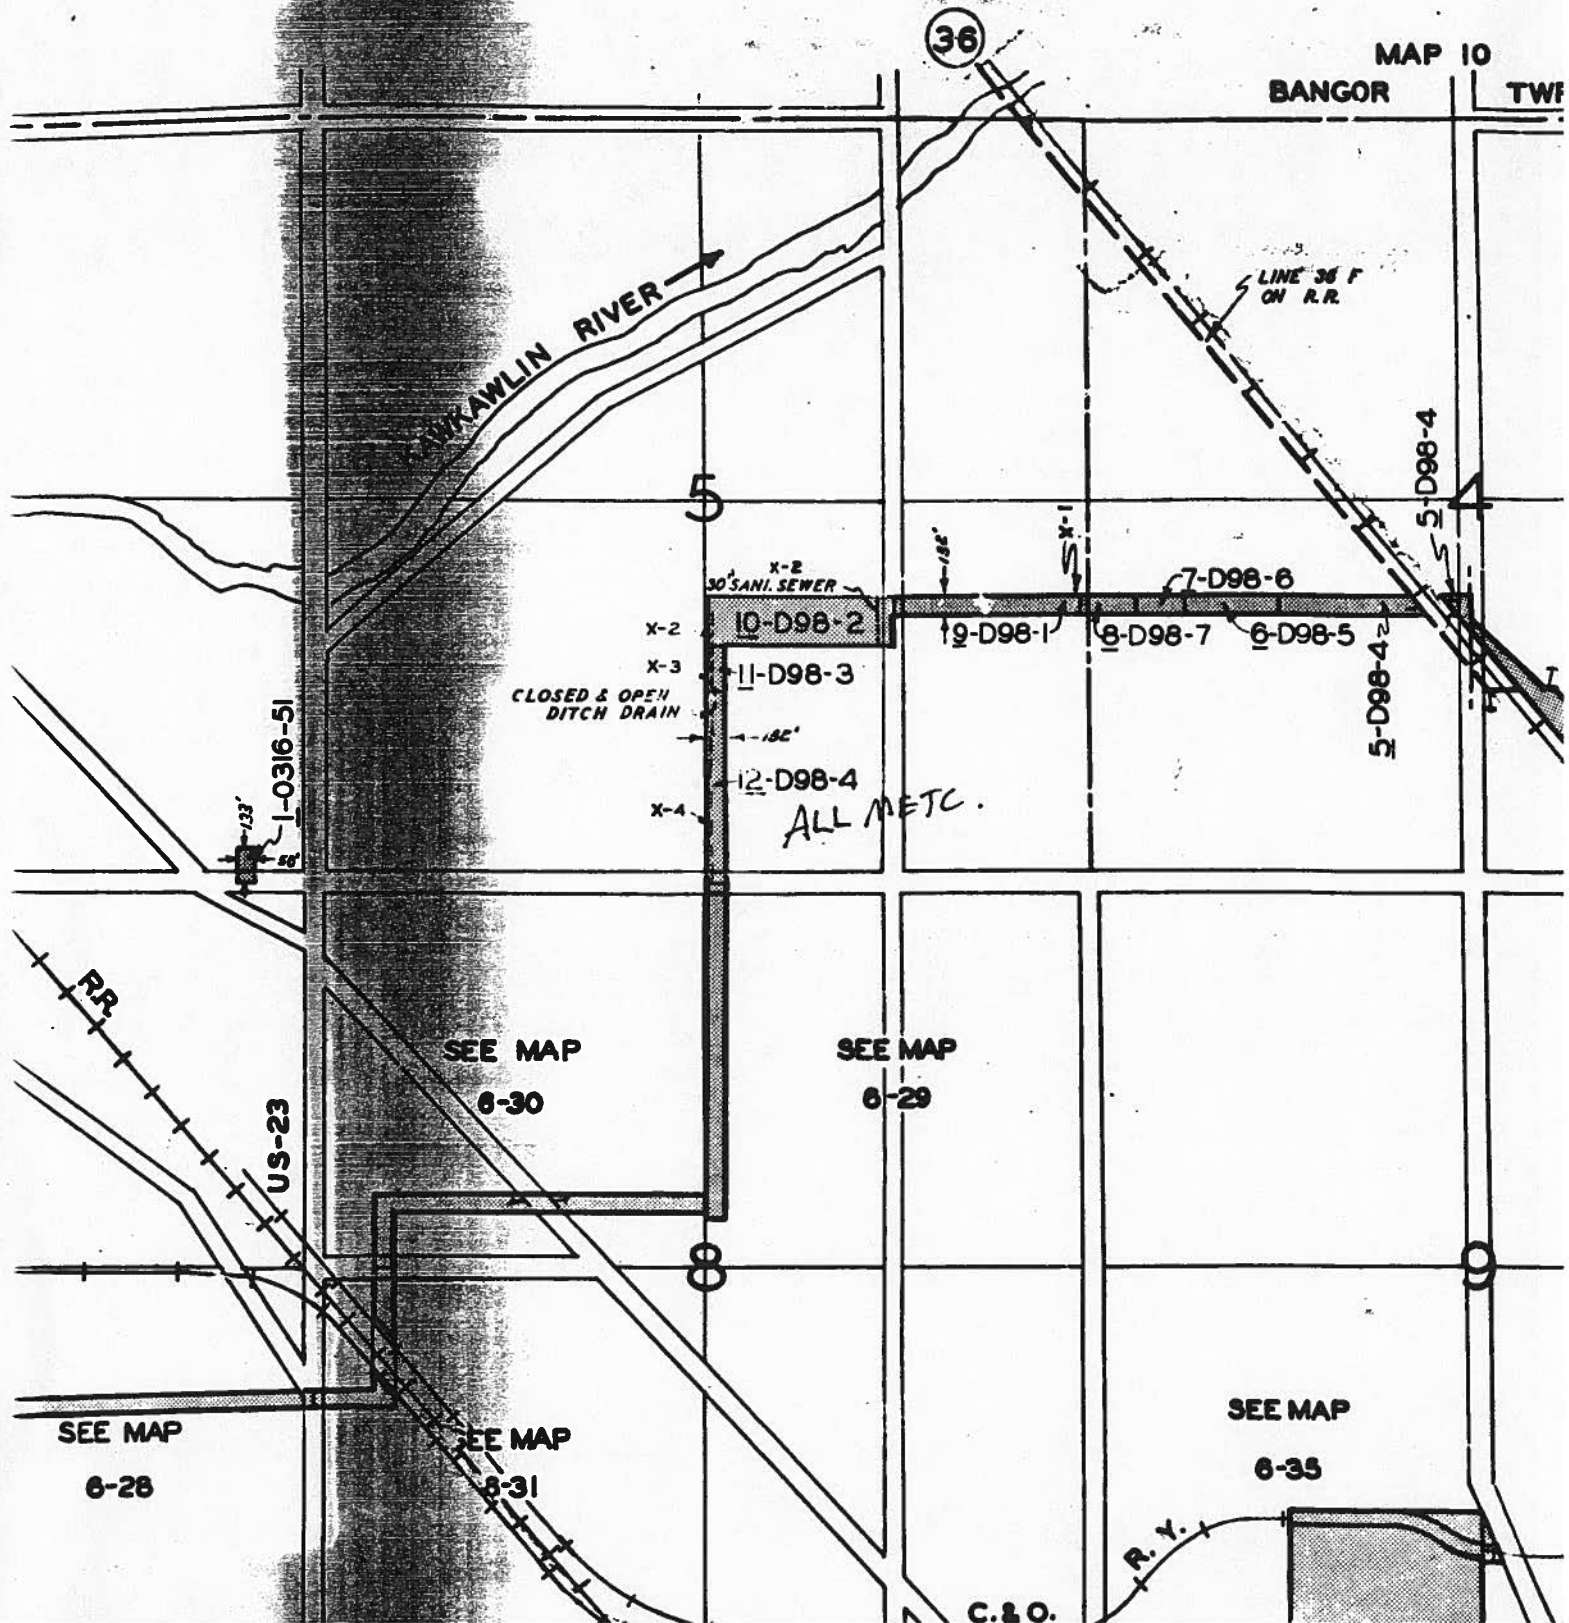



2 INSTALL  
25 KVA RF  
PER 66-106-1

- UNDERGROUND LEGEND**
- 1. Single-phase primary
  - 2. Three-phase primary
  - 3. Single-phase secondary
  - 4. Three-phase secondary
  - 5. Three-phase power secondary
  - 6. Single-phase service and power service
  - 7. Three-phase service and power service
  - 8. Single-phase service and power service (LCP)
  - 9. Three-phase service and power service (LCP)
  - 10. Strengthening conductor (LCP-1/0 AL)
  - 11. Covered 600V neutral conductor for ducts
  - 12. Strengthening conductor (LCP-1/0 AL)
- CONDUIT**
- 13. Plastic
  - 14. Fiberglass
  - 15. Epoxy
- CABLE MATERIAL AND SIZE**
- 16. 3/4" Steel
  - 17. 3/4" Steel
  - 18. 1/2" Steel
  - 19. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 20. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 21. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 22. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 23. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 24. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 25. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 26. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 27. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 28. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 29. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 30. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 31. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 32. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 33. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 34. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 35. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 36. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 37. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 38. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 39. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 40. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 41. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 42. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 43. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 44. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 45. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 46. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 47. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 48. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 49. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 50. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 51. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 52. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 53. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 54. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 55. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 56. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 57. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 58. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 59. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 60. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 61. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 62. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 63. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 64. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 65. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 66. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 67. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 68. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 69. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 70. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 71. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 72. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 73. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 74. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 75. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 76. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 77. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 78. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 79. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 80. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 81. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 82. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 83. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 84. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 85. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 86. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 87. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 88. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 89. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 90. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 91. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 92. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 93. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 94. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 95. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 96. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 97. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 98. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 99. No. 1/0 AL, cable, 175 mils, 15kV, or secondary
  - 100. No. 1/0 AL, cable, 175 mils, 15kV, or secondary

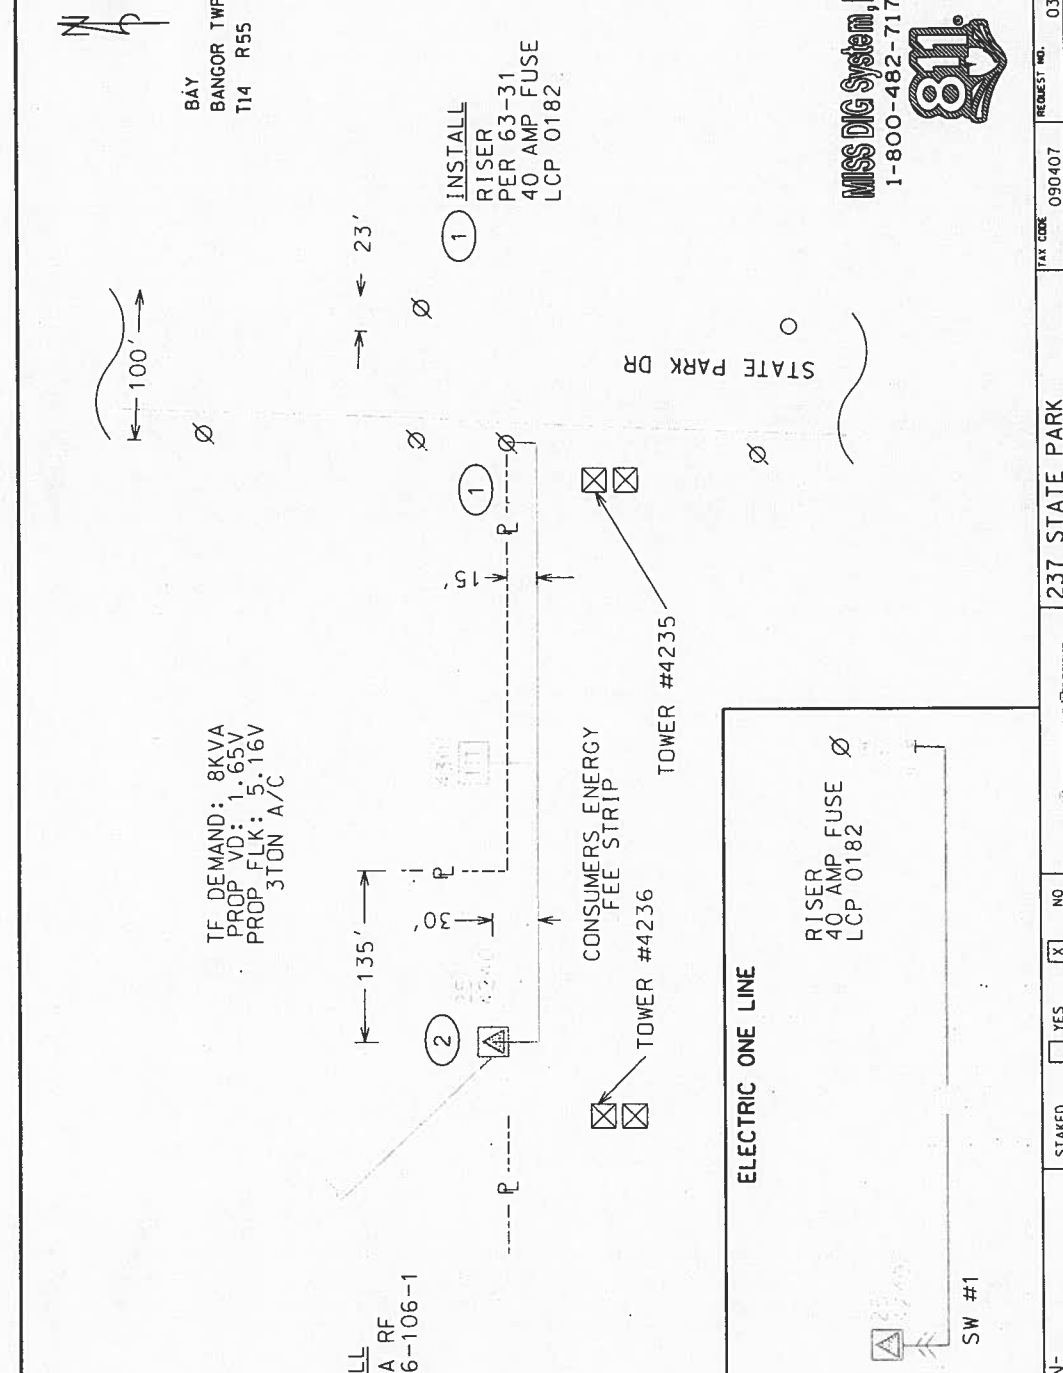

TF DEMAND: 8KVA  
PROP VD: 1.65V  
PROP FLK: 5.16V  
3TON A/C

BAY CO  
BANGOR TWP  
T14 R55 SEC. 05



TAX CODE	090407	REQUEST NO.	03150471
UTIL. TYPE	EU	TYPE	WORK ORDER
CATEGORY	NBUS	JTLN	06808808
WD NO.	0214	CAD FILE:	06808808.001
CUT NO.	02	LCP NO.	0632
CIRCUIT	PATTERSON		
SUBSTATION	PATTERSON		
DESIGNED BY	SNYALKER	DATE	05/19/08
APPROVED BY		SCALE	1"=80'
SHEET	1 OF 1		

**CONSTRUCTION CERTIFICATION**  
Work was constructed as Engineered or Changed as Indicated.  
All Salvageable Material Was Returned to Stores.

Signed: \_\_\_\_\_ in Direct Charge of Work  
 Dates: Started \_\_\_\_\_ Completed \_\_\_\_\_ DATE: \_\_\_\_\_


MISS DIG NUMBER: \_\_\_\_\_

ELECTRIC CAD TITLE BLOCK (1/1/17) 6-11-2001  
 SHEET B  
 DATES STIMES FILES  
 T R S 145505



WATER WORKS SPUR STATION

# VENONA BEACH

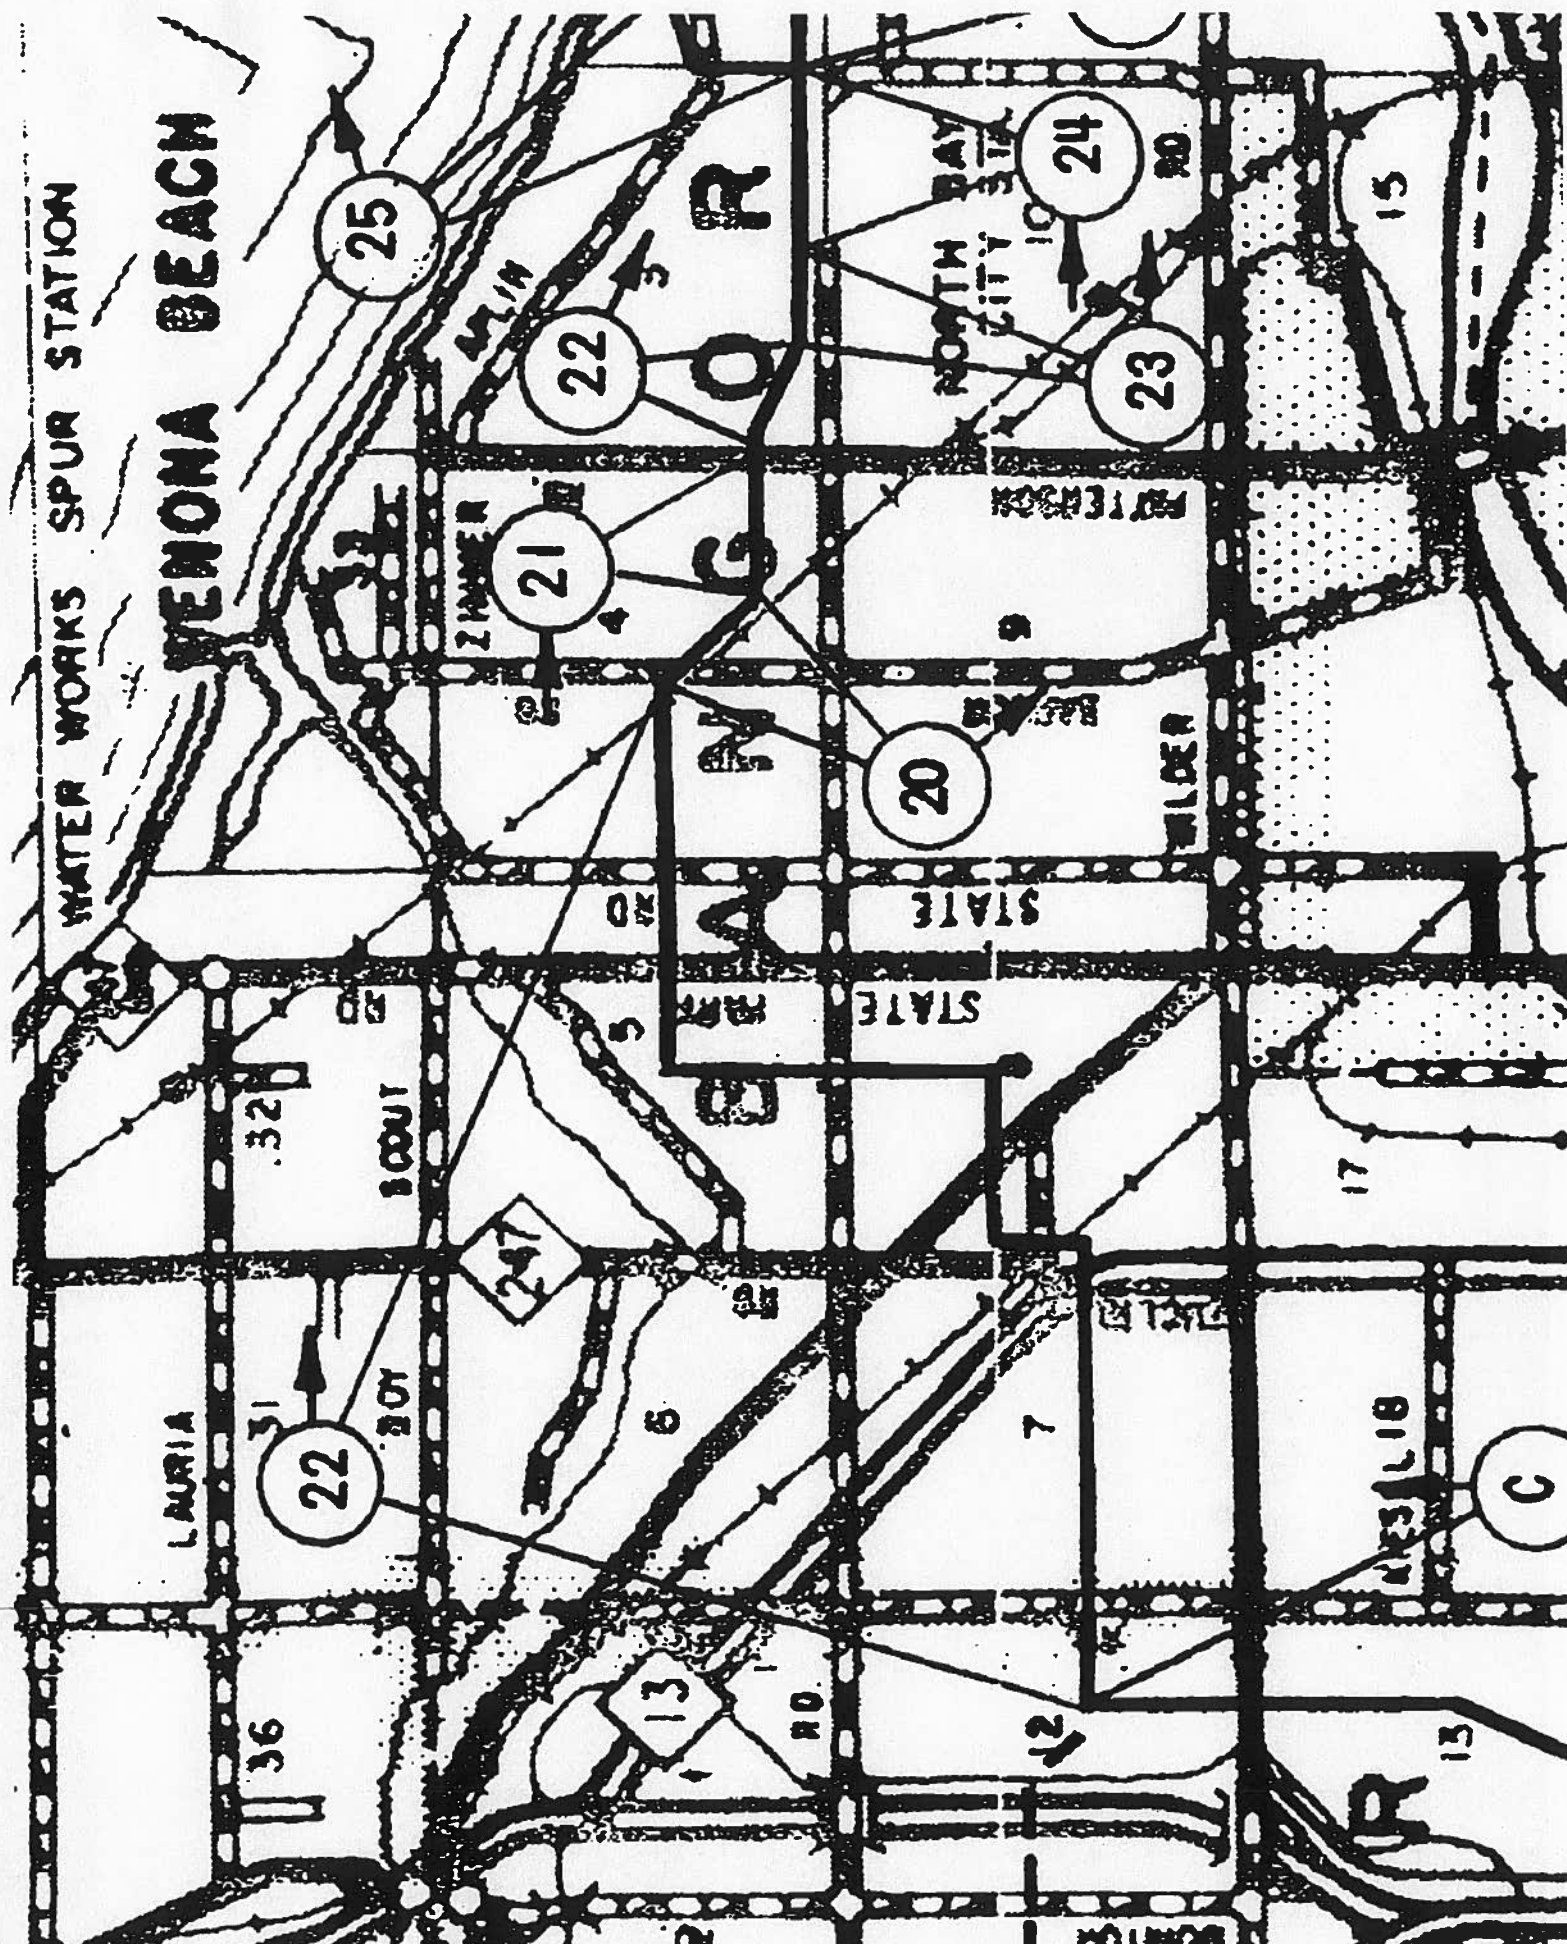

LAURIA

36

22

32

SCOUT

31

247

21

ZIMMER

22

25

3

O R

G

M

A

STATE

6

13

20

STATE

STATE

7

12

NORTH BAY CITY STA

23

24

10

PETERSON

9

STATE

WILDER

13




15

17


18

18

(C)

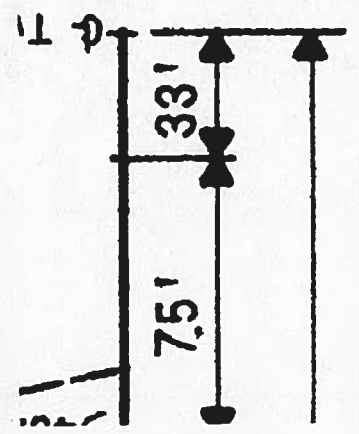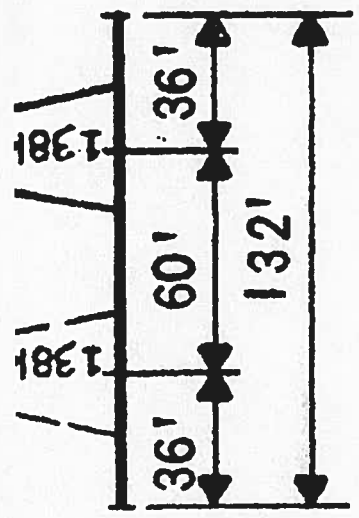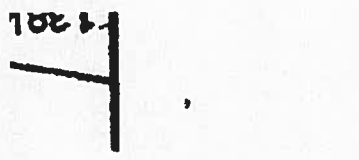

23

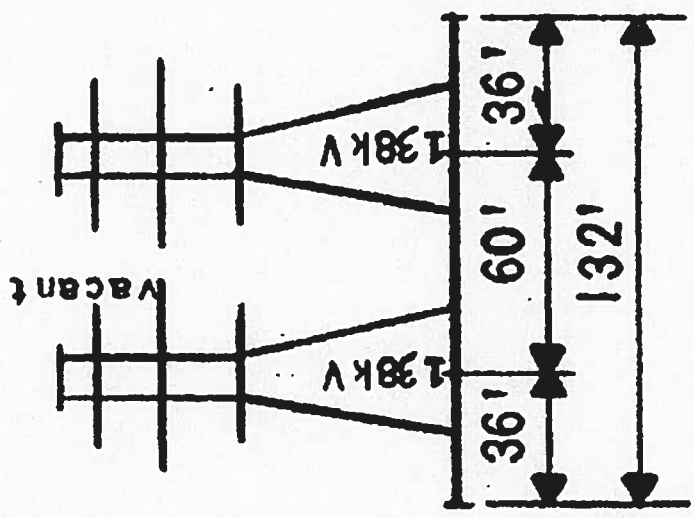

22

