



STATE OF MICHIGAN

Office of the Michigan Public Utilities Commission, } ss.

I, Clarke W. Brown, Secretary of the Michigan Public Utilities Commission

Do Hereby Certify, That I have compared the annexed copy of Permit ED2-8- 339

with the original

recorded in File ED2-8-339

and that it is a true and correct transcript therefrom, and of the whole of such original.

*Could not locate Renewed Permit.*

*4046*

*4046*

In Testimony Whereof, I have hereunto set my hand and affixed

the seal of the Commission, at Lansing, this 28th

day of September in the year of our Lord

one thousand nine hundredthirty-six

*Clarke W. Brown*

Secretary Michigan Public Utilities Commission

*30190 P35*

THE DETROIT EDISON CO  
PLAN SUBMITTED TO MICHIGAN PUBLIC UTILITIES COMMISSION

FOR  
OVERHEAD LINE CROSSING  
OVER MICHIGAN CENTRAL R.R. AND DETROIT-TOLEDO & BRANTON R.R.  
VILLAGE OF ECORSE PC 42 ECORSE TOWNSHIP WAYNE COUNTY  
CITY OF RIVER ROUGE I-3-S R.I.E.

CIRCUITS NUMBER	VOLTAGE	CYCLES	PHASE	USE	CONDUCTORS WIRE SIZE	KIND
1	4800	60	3	DISTRIBUTION	3	M.H. STR. TEMP. COPPER
2	4800	60	3	"	3	M.H. STR. TEMP. COPPER
3	4800	60	3	"	3	M.H. STR. TEMP. COPPER
4	5000 (M.A.)	60	3	"	3	M.H. STR. TEMP. COPPER
5	5000 (M.A.)	60	3	"	3	M.H. STR. TEMP. COPPER























POLES LOCATION	LENGTH	MATERIAL	CIRCUMFERENCE AT TOP	ALGROUNDS SETTING	DEPTH OF SETTING	KIND OF SETTING
A-B-F	45'	WESTERN CEDAR	27"	31"	6'-6"	CLAY JOIL
G	45'	"	27"	31"	6'-6"	"
H	45'	"	27"	31"	6'-6"	"
I	45'	"	27"	31"	6'-6"	"
J	45'	"	27"	31"	6'-6"	"
K	45'	"	27"	31"	6'-6"	"
L	45'	"	27"	31"	6'-6"	"
M	45'	"	27"	31"	6'-6"	"
N	45'	"	27"	31"	6'-6"	"
O	45'	"	27"	31"	6'-6"	"
P	45'	"	27"	31"	6'-6"	"
Q	45'	"	27"	31"	6'-6"	"
R	45'	"	27"	31"	6'-6"	"

NOTE  
MATERIALS SHALL BE AS NOTED IN THE DETROIT EDISON COMPANY'S STANDARD SPECIFICATIONS FOR OVERHEAD LINE CONSTRUCTION AT RAILROAD CROSSINGS ISSUED DECEMBER 23 1915

PURPOSE OF LINE  
ADDING 2 # 4800 VOLT ST. LITE Wires.  
EXISTING PERMITS ED 2-8-339 AND ED 2-8-340

APPROVED FOR  
MICHIGAN PUBLIC UTILITIES COMMISSION  
DATE 3-1-38 CHECKED BY J.A.L. DATE 3-1-38

DRAWN BY B.C. DATE 3-1-38  
FILED D-2-8-339 DATE MAR 2 8 1938

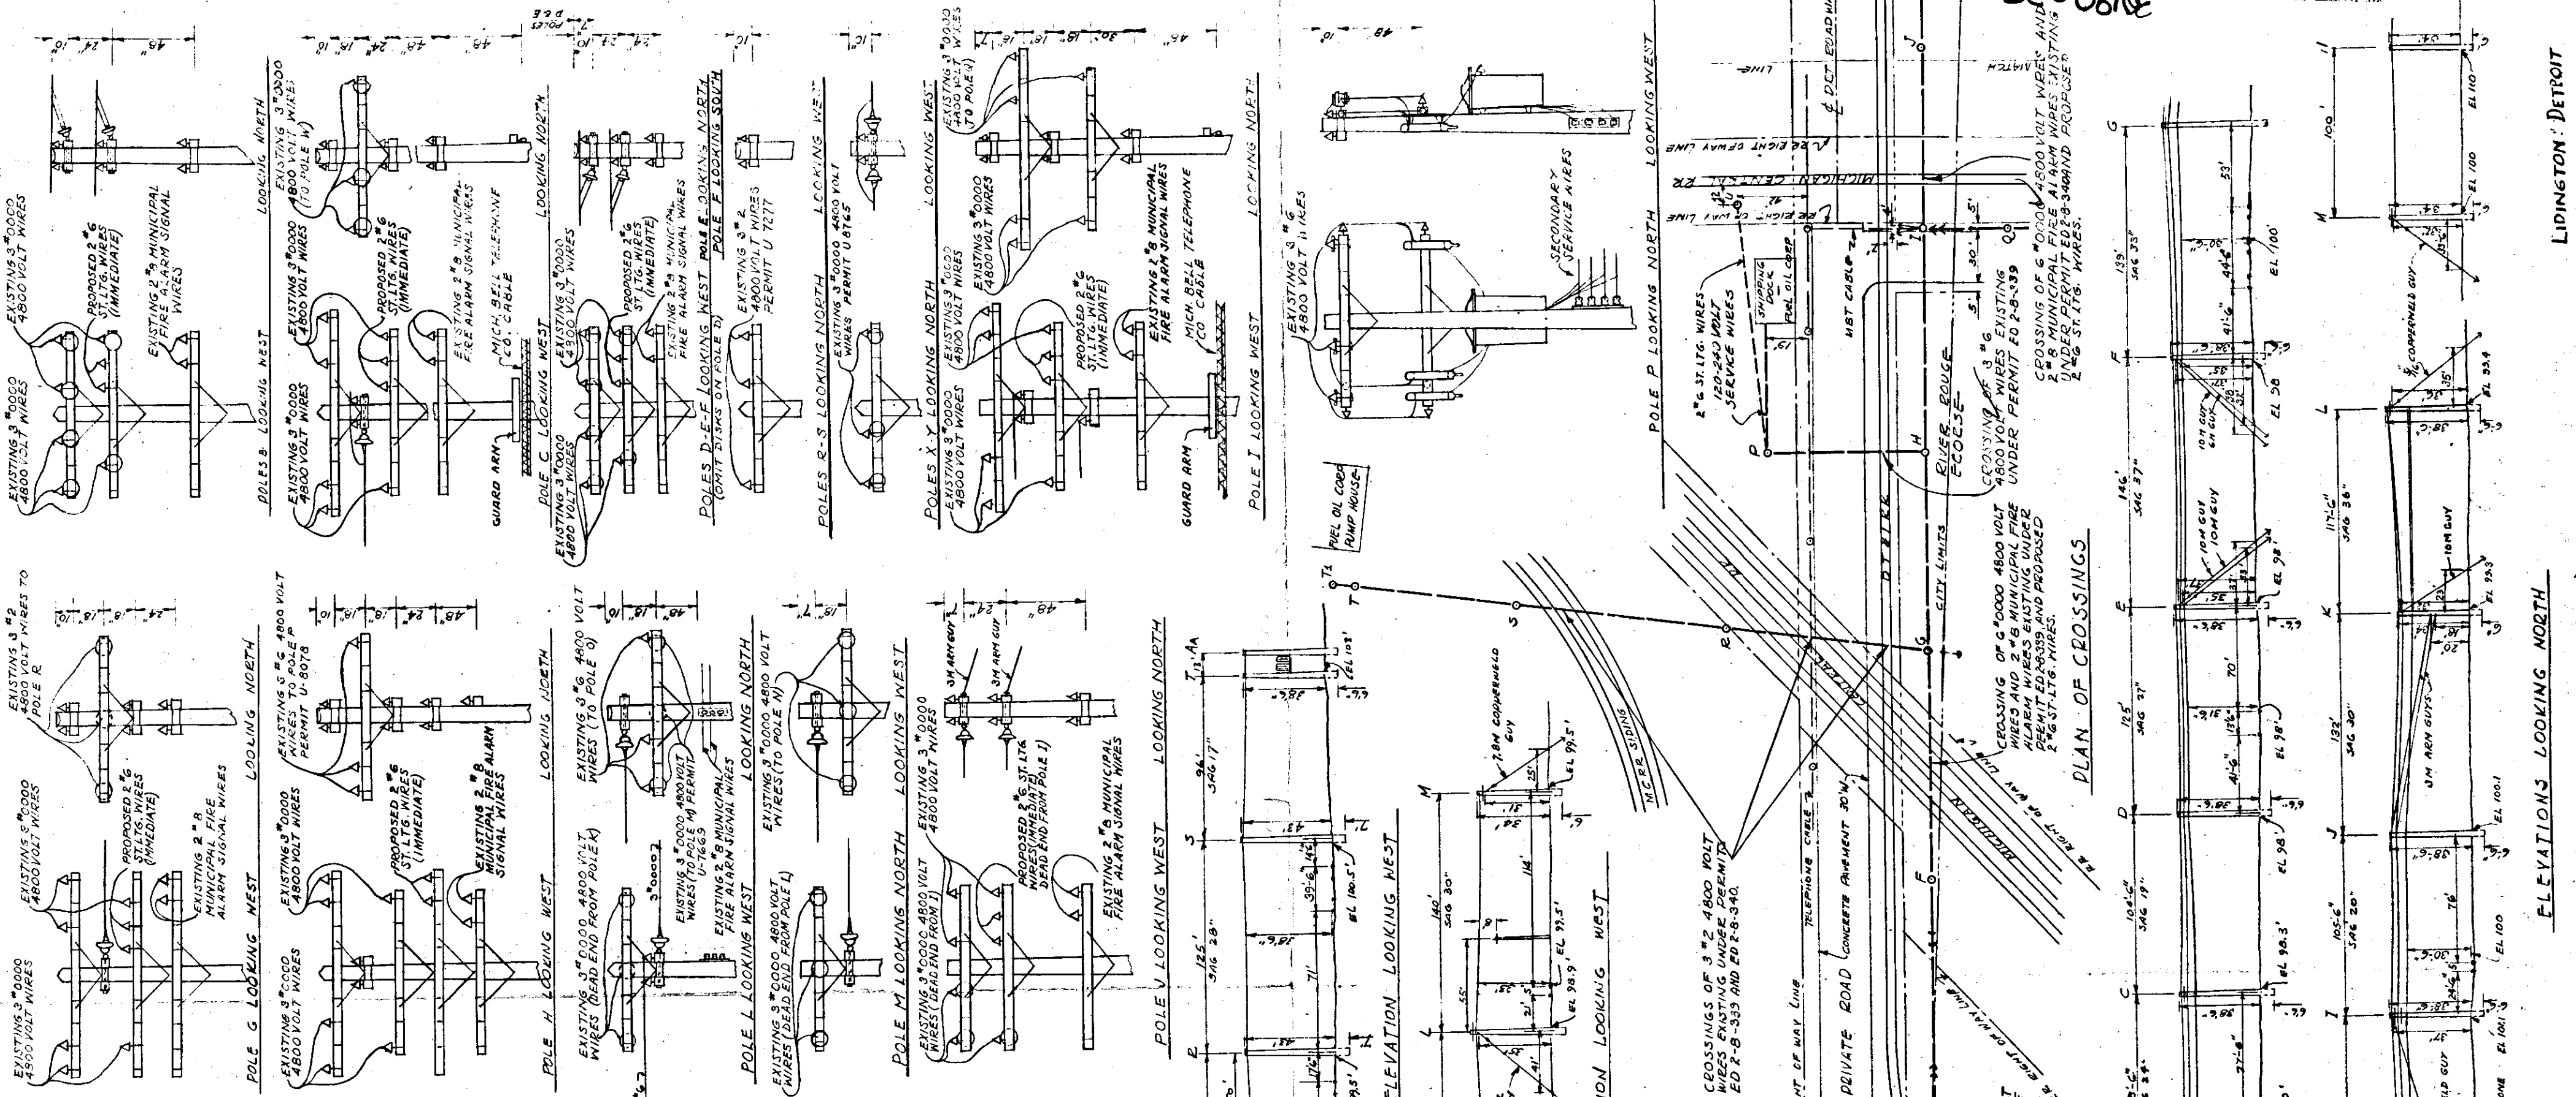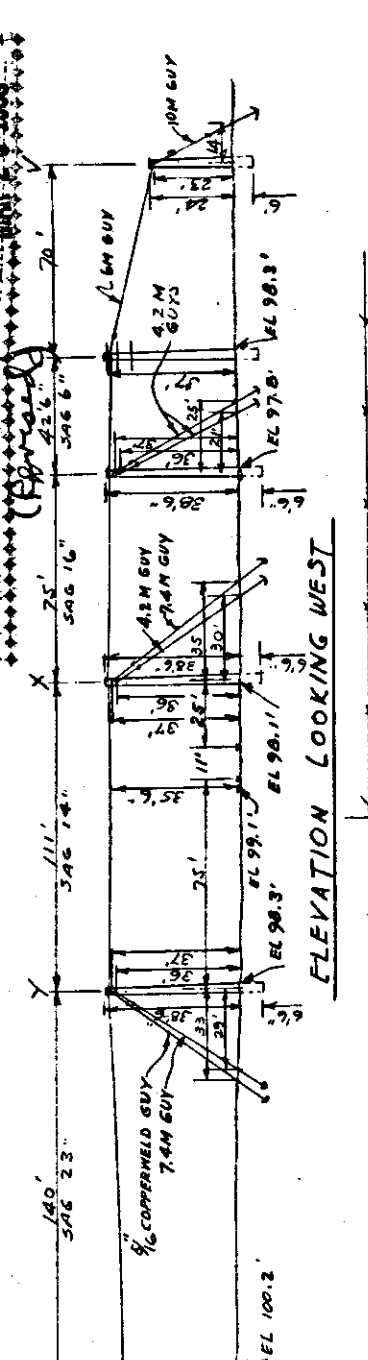

RECORDED RIGHT OF WAY NO. 30190 P35

RT-1608 B  
DIT